

BCDMH Vs DBDMH

Relative Distribution of Free & Total Cl

Simulated Cooling Water: pH 9.1, Temp 100 F, CH = 400 ppm, TA = 300 ppm

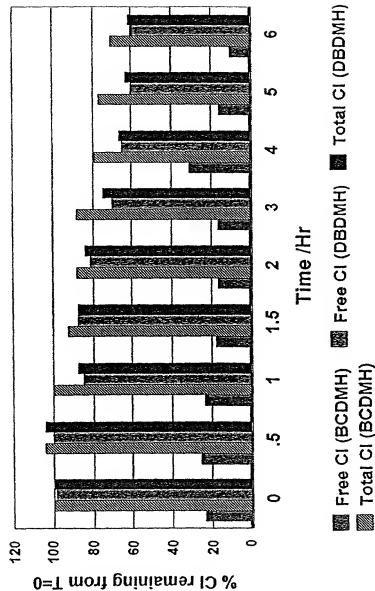


Fig. 1

BCDMH Vs DBDMH

Simulated Cooling Water: pH 9.1, Temp 100 F, CH = 400 ppm, TA = 300 ppm

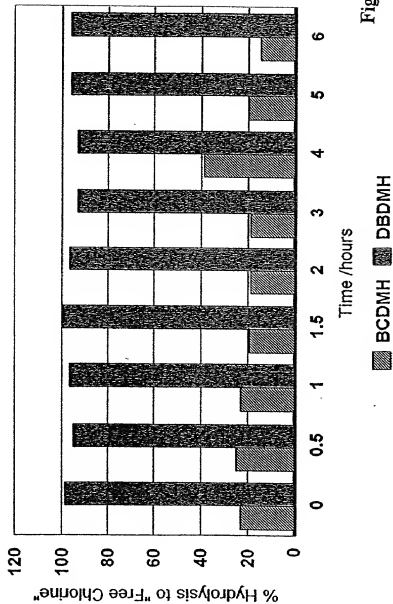


Fig. 2